

ADDENDUM NO. 1

June 15, 2018

**GREENVILLE UTILITIES COMMISSION
GCP-10094 THOMAS LANGSTON ROAD ENHANCEMENTS
DRAWING NO. W-3749**

A. SCOPE

This Addendum No. 1 consists of pages AD1-1 through AD1-5.

BIDDERS are hereby notified of the following changes in the specifications and/or drawings.

B. SPECIFICATIONS

NONE

C. DRAWINGS

1. SHEET C1 – PLAN-PROFILE – Sta. 0+00 to Sta. 11+50

Replace Sheet C1 with the attached revised Sheet 1.


The alignment of the second directional bore was changed to satisfy NCDOT requirements.

See attached Figure No. 1 (Page AD1-2)

CI. GENERAL





1. Attached is a copy of a Memorandum (AD1-3 through AD1-5) which documents the minutes from the Pre-Bid Conference held on Thursday, June 14, 2018.

This Addendum No. 1 is submitted this 15th day of June, 2018. Each BIDDER is requested to acknowledge receipt of this Addendum in the space provided in the Bid Form.

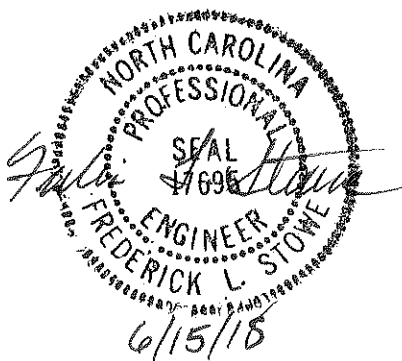

RIVERS & ASSOCIATES, INC.
107 East Second Street
Greenville, North Carolina 27858

P:\Main\GUC - Thomas Langston Road Enhancements - 201704\GUC - Thomas Langston Road Enhancements.dwg, 6/12/18, C:\Users\JL\Documents\201704\GUC - Thomas Langston Road Enhancements.dwg, 6/12/18, 11:53:59 AM

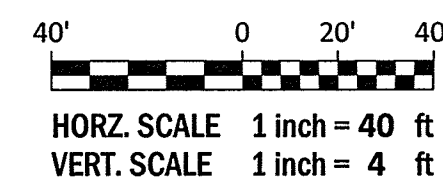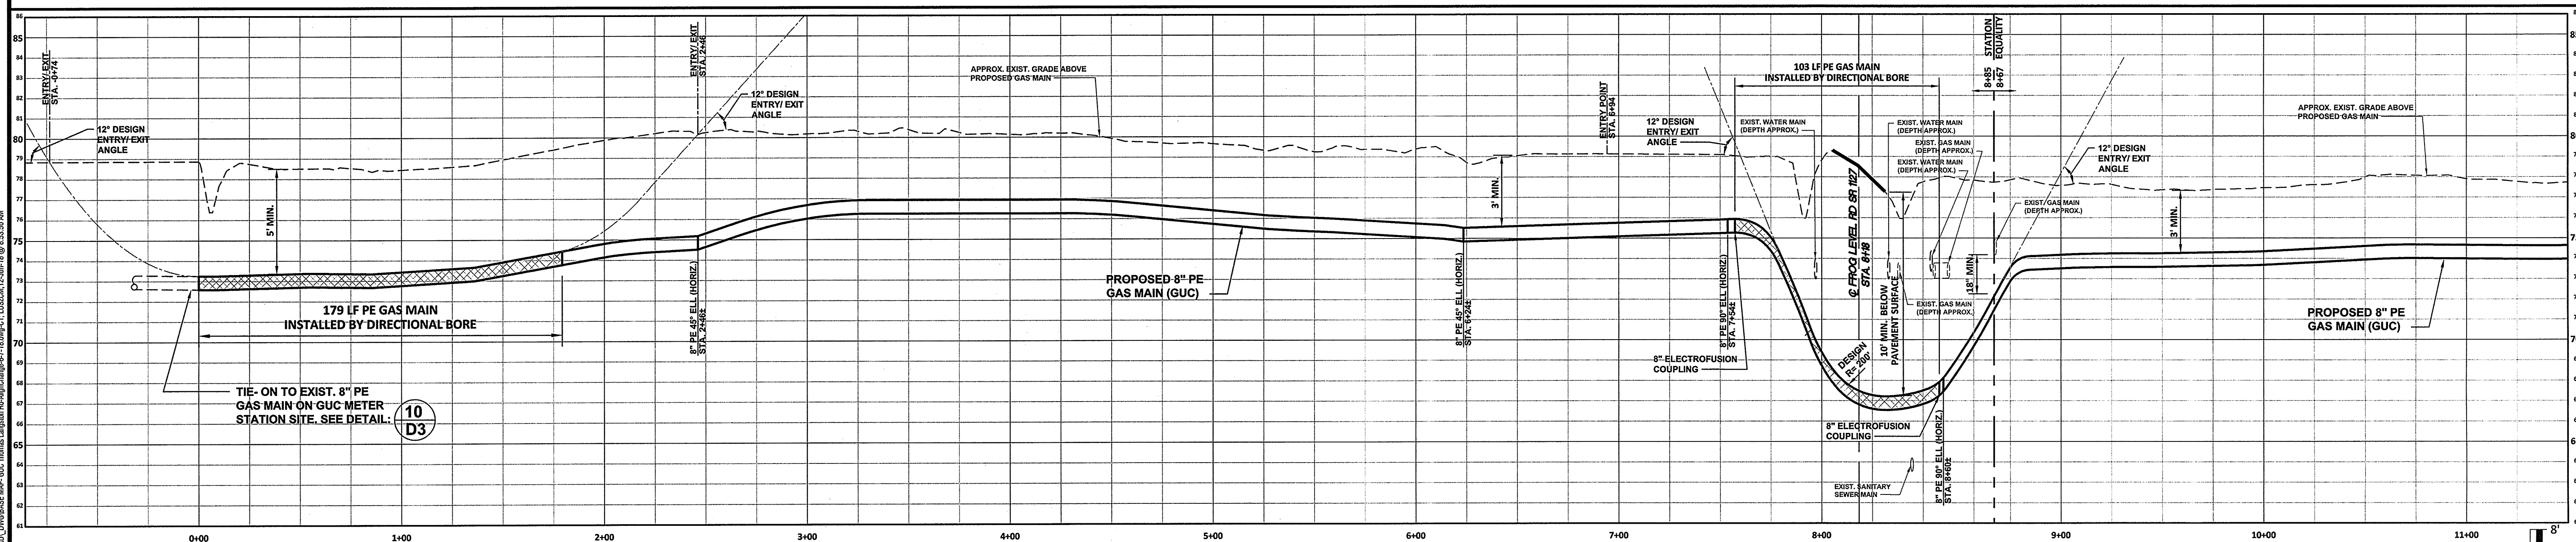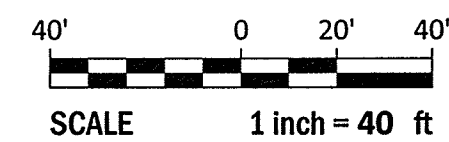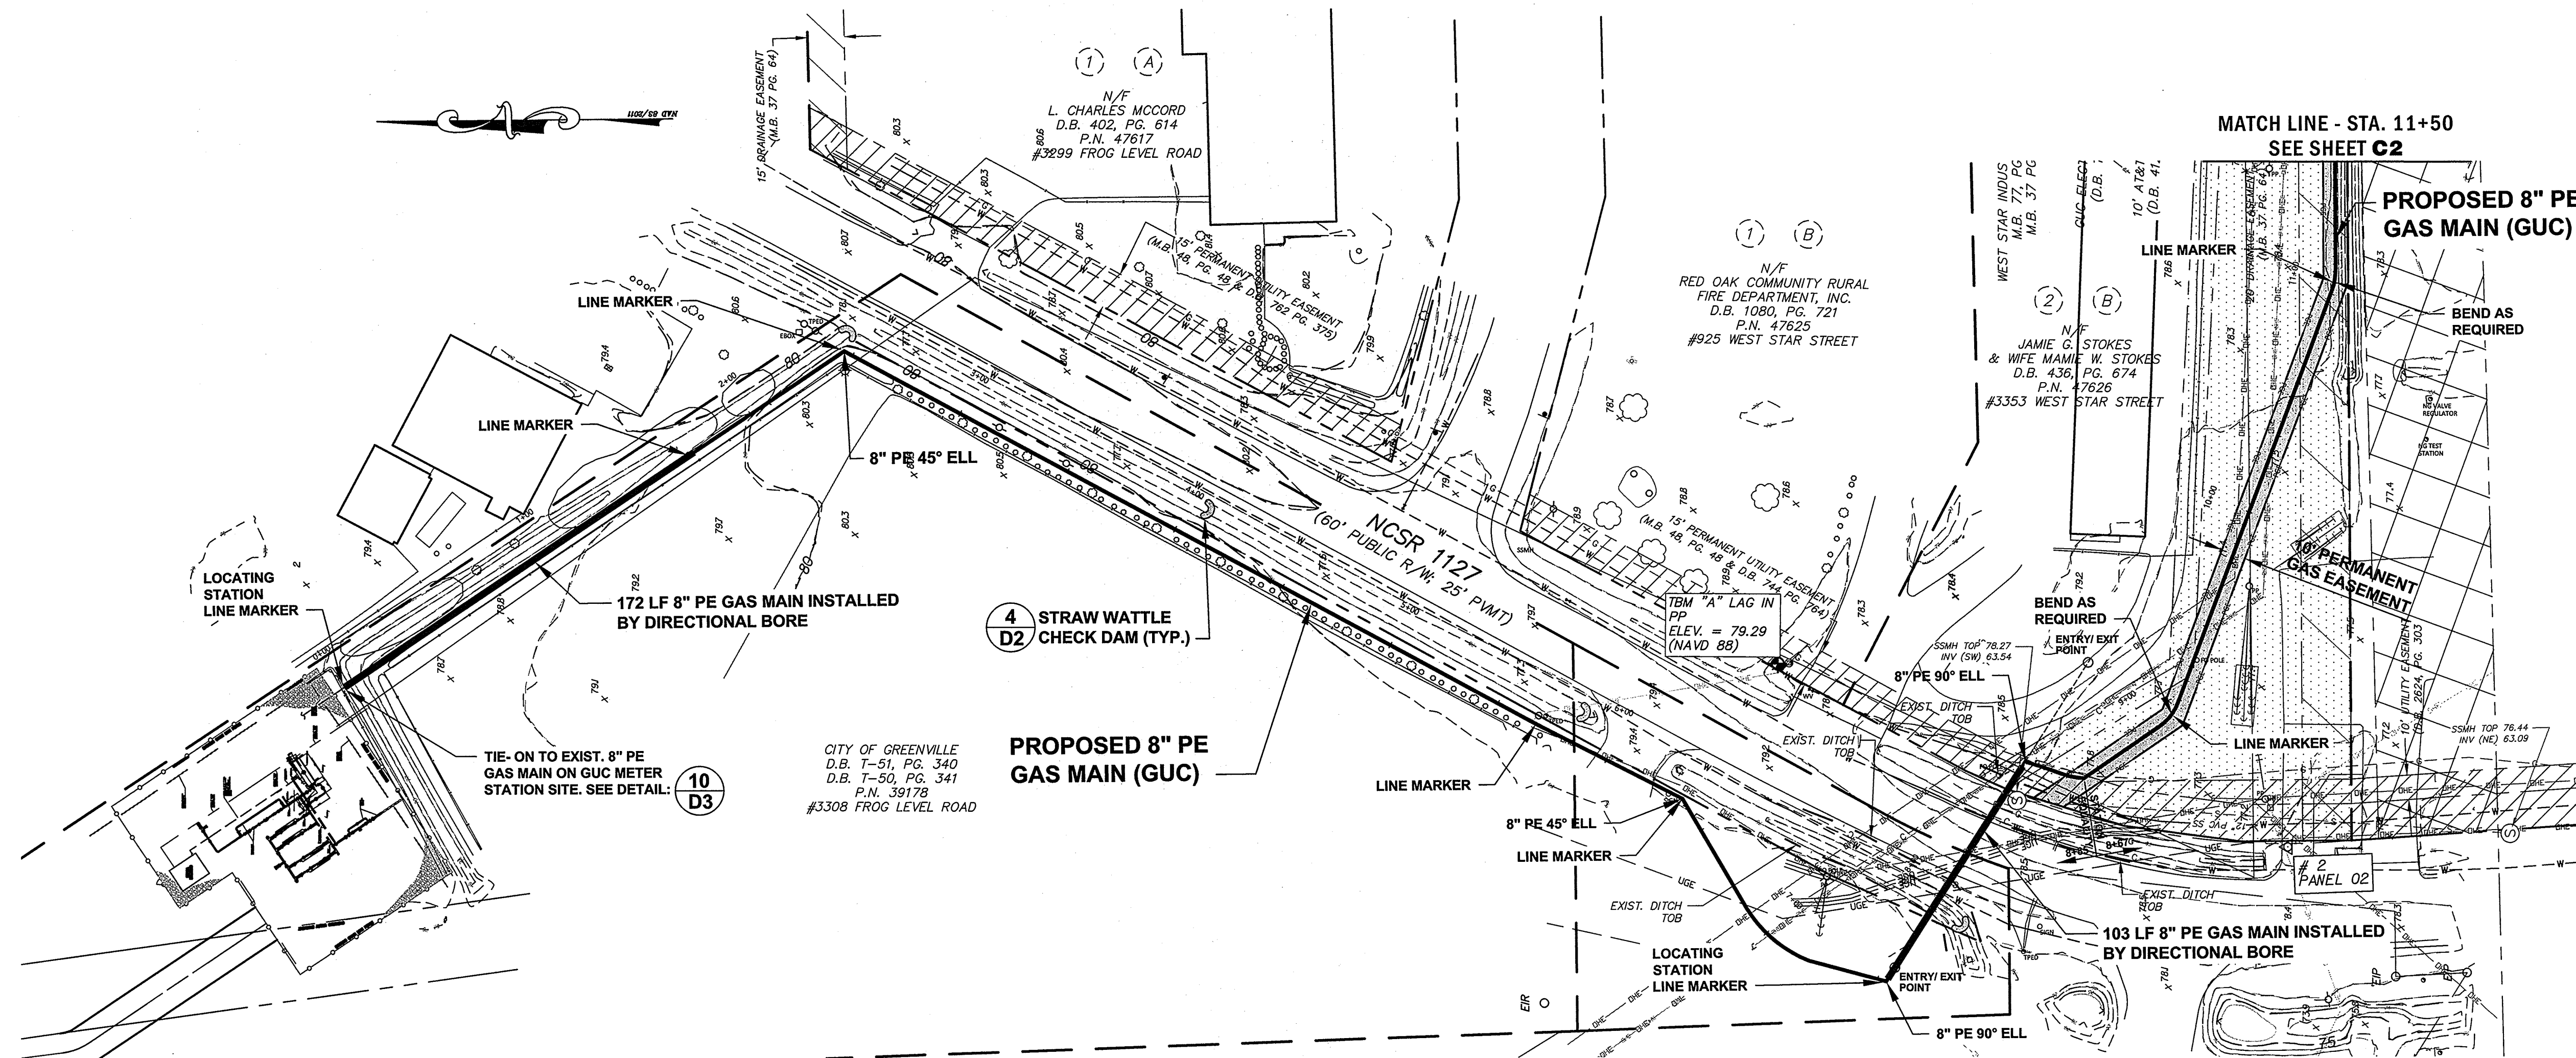

REVISIONS:	
REV.	DESCRIPTION
1	APPD

Greenville Utilities

PLAN SHEET
GREENVILLE UTILITIES COMMISSION
GCP-10094 THOMAS LANGSTON
ROAD ENHANCEMENTS
NORTH CAROLINA
PITT COUNTY

Rivers & Associates, Inc.
Professional Engineer
No. 17893
6/12/18
JML
DESIGN FLS
CHECK FLS
PROJECT No. 2017024
DRAWING No. W-3749
SCALE: 1"=40'
SHEET No. OF 24
C1

"Celebrating 100 Years of Service" 1918-2018
MEMORANDUM

TO: Attendees and Planholders

FROM: Seth Anderson, E.I.

SUBJECT: Pre-Bid Conference Minutes
Greenville Utilities Commission
GCP-10094 Thomas Langston Road Enhancements

DATE: June 15, 2018

A Pre-Bid Conference for the subject project was held in the Engineering Center Conference Room of Greenville Utilities Commission (GUC) at 801 Mumford Road, Greenville, NC 27834 on Thursday, June 14, 2018 at 10:00 a.m. Attendance was documented on a sign-in sheet, a copy of which is attached to this memorandum.

Following the welcome and introductions, Durk Tyson conducted a safety briefing. Rivers and Associates then provided a short project overview and shared the following information with the attendees:

- The scope of the project generally includes:
 - Construct, test, purge, and gas-up of the Thomas Langston Road Enhancements Project.
 - The proposed 8-inch PE natural gas main is approximately 3.4 miles in length. The route of the proposed gas main begins at Frog Level Road and follows easements cross country to Thomas Langston Rd, and terminates at Pitt Community College near the NC-11 ROW.
 - Construction will be within GUC utility easements and/or public utility easements.
 - As designed, there are seventeen (17) horizontal directional drills (HDDs) and one (1) jack and bore, the remainder of the construction is designed to be performed by conventional means.
 - The new gas main is to be air tested to 90 psig for a maximum allowable operating pressure (MAOP) of 60 psig.
- Although the Owner and Engineer will make a sincere effort to answer all questions to the best of their ability, Bidders are reminded to rely only on written information contained in the Contract Documents and Addenda.
- Attendance at the Pre-Bid Conference is not mandatory. Minutes of the Pre-Bid will be prepared and issued to all plan holders.
- Bids will be received on Thursday, June 28, 2018 at 10:00 a.m., in the same location as the Pre-Bid Conference (Engineering Center Conference Room at 801 Mumford Road, Greenville, NC 27834). Refer to the Advertisement to Bidders for details on submitting the Bid.
- Upon receipt of satisfactory bids, GUC expects to proceed with awarding the contract and beginning construction. The contract time limit for this project will be 120 consecutive calendar days and liquidated damages are set at \$500.00 per calendar day.

- Questions that arise prior to opening of bids should be directed to the Engineer with a copy to the Owner in accordance with Article 7.02 of the Instructions to Bidders. Questions received less than seven (7) days prior to the date of the opening of Bids may not be answered.
- This will be a unit price contract (refer to Bid Schedule, Page 5 – Bid).
- Bid bond or Bid deposit in an amount equal to not less than five percent (5%) of the proposal is required.
- Performance bond and payment bond are required.
- Properly completed and executed Bid Proposal Package with original signatures and seals, is required.
- Compliance with the Greenville Utilities Commission M/WBE Program is required. The appropriate completed MB forms must be submitted with the bid.
- GUC will provide the materials listed in the Bill of Materials on Sheet T2 of the construction plans (TS 3.3.1). Any major errors in the anticipated quantities should be brought to the Owner's attention.
- The contract does not include any provisions for rock excavation as it is not anticipated on this project. A soils report is included in the bid documents.
- The Contractor shall submit a current copy of their Operator Qualifications (TS 1.4), Drug Testing (TS 1.5) programs in accordance with the project specifications. GUC may require Contractor's personnel to re-qualify on certain items such as fusion.
- GUC will provide personnel to inspect and collect as-built information for this project (TS 3.5.1). GUC Gas crews' normal work hours are 10 hour days / 5 days a week. The contractor may be allowed to perform non-covered tasks outside of normal work hours.
- The Contractor shall provide bore logs for all pipe installed by horizontal directional drills.
- One known item to be addressed by Addenda is a change to the bore across Frog Level Rd. on sheet C1.
- After the bid opening, GUC Gas Department will get approval at the July meeting of GUC Commissioners with the goal of the project being completed by the start of heating season 2018
- All easements have been obtained except for one (1) that is under negotiation; however, condemnation proceedings have begun so acquisition will not interfere with the schedule of the project.
- The Pre-Bid Conference was ended at 10:30 AM.

PRE-BID MEETING
Thursday, June 14th, 2018 @ 10:00 a.m.

Greenville Utilities Commission

GCP-10094 Thomas Langston Road Enhancements

801 Mumford Road

<u>Name</u>	<u>Affiliation</u>	<u>Telephone</u>	<u>Email Address</u>
Durk Tyson, P.E.	Greenville Utilities Commission	(252) 551-2048	tysonfd@guc.com
Dillon Wade	Greenville Utilities Commission	(252) 551-1594	wadede@guc.com
Fred Stowe, P.E.	Rivers and Associates	(252) 752-4135	fstowe@riversandassociates.com
Seth Anderson	Rivers and Associates	(252) 752-4135	sanderson@riversandassociates.com

[illegible]