


96"

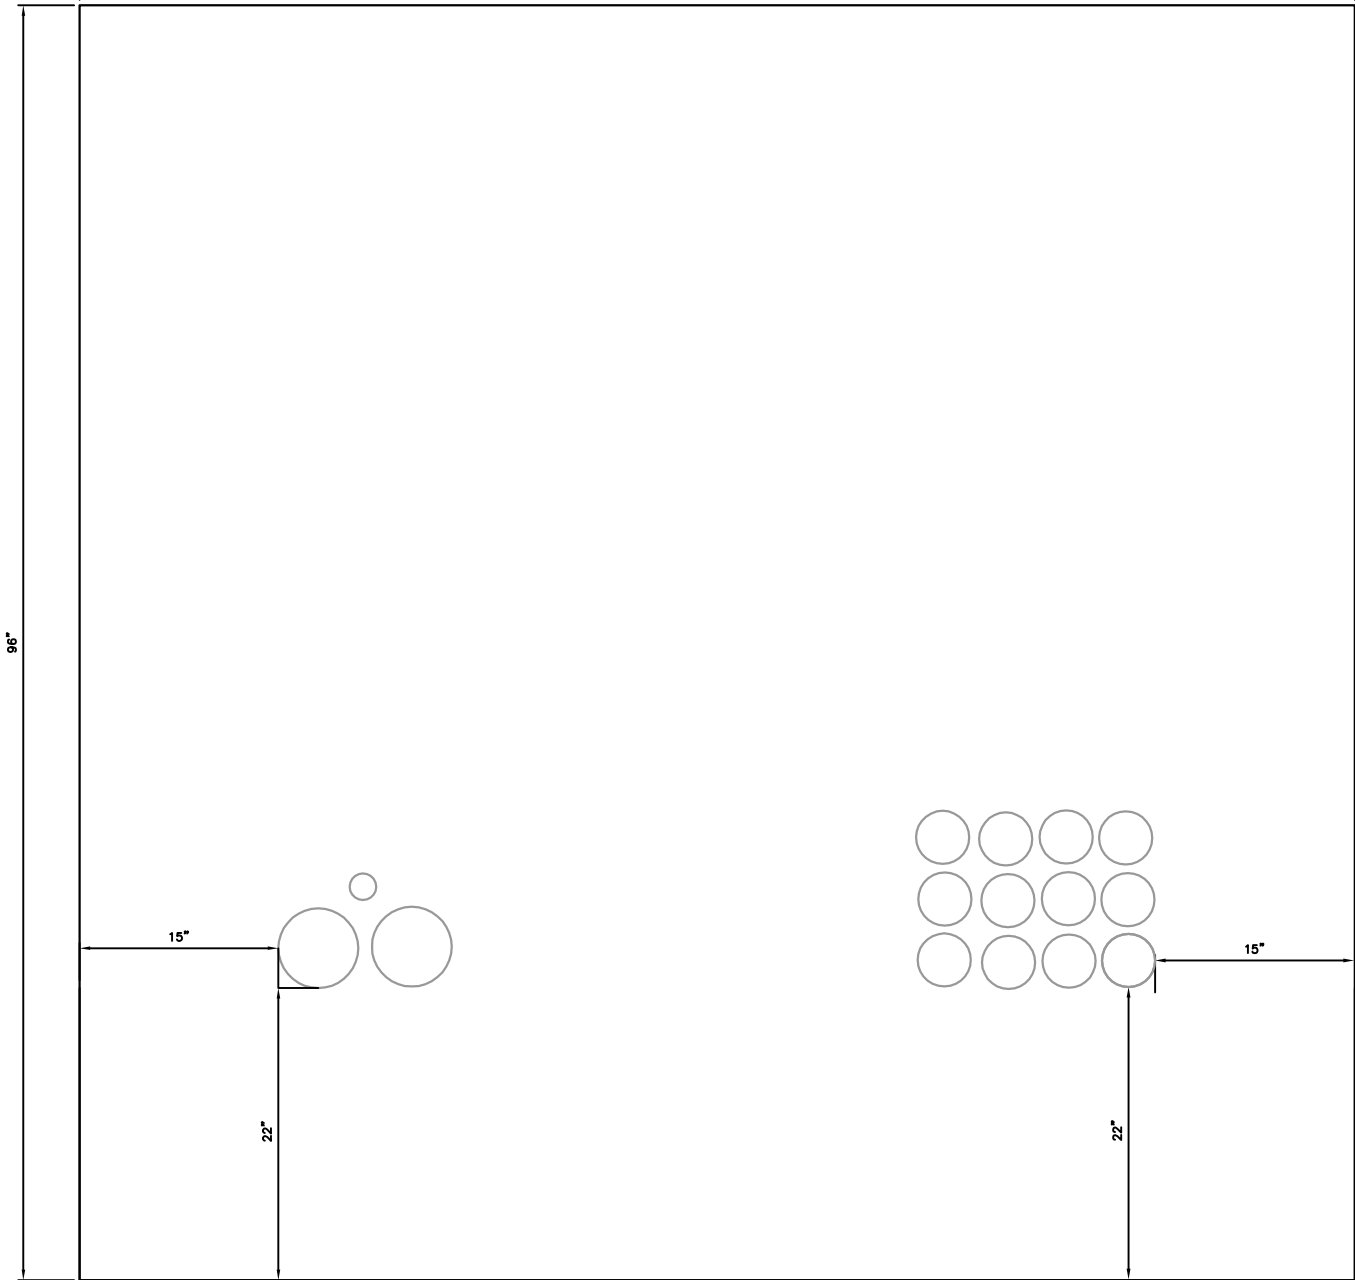

FRONT OF TRANSFORMER

NOTES:

- 1) 6" PVC CONDUITS WITH GALVANIZED RIGID 90s AT A DEPTH OF 3 FT FOR GREENVILLE UTILITIES AND (1) 2" PVC SLEEVE FOR GROUND ROD
- 2) CONDUIT SHALL EXTEND A MINIMUM OF 24" ABOVE PAD
- 3) CONDUIT SHALL BE UN-DAMAGED AND FREE OF DEBRIS AT TIME OF INSTALLATION
- 4) APPROPRIATE PULL STRING SHALL BE INSTALLED IN EACH PIPE AT TIME OF INSTALLATION
- 5) ALL CONDUIT ENDS, FITTINGS, ELBOWS ETC. SHALL BE GLUED TO ENSURE SECURE CONNECTION
- 6) CONDUIT ENDS SHALL BE CAPPED OR TAPED AS TO PREVENT WATER OR OTHER DEBRIS FROM ENTERING THE CONDUIT
- 7) WHERE APPLICABLE, CONDUIT ENDS SHALL BE MARKED "1", "2", "3" ETC. AS TO ADEQUATELY IDENTIFY CORRESPONDING PIPE ENDS
- 8) 10 FT. MINIMUM CLEARANCE ON FRONT AND BACK OF TRANSFORMER
- 9) 5 FT. MINIMUM CLEARANCE ON SIDES OF TRANSFORMER
- 10) SIZE AND NUMBER OF CONDUITS VARIES
- 11) THICKNESS OF PAD SHALL BE 8" CONCRETE POURED SOLID WITH NO OPENING



Greenville Utilities
 PO BOX 1847 • GREENVILLE, NC 27835
 ELECTRIC ENGINEERING (252) 551-1582

CONDUIT INSTALLATION SPECIFICATIONS - 8' X 8' TRANSFORMER PAD

| | | | |
|------------|-------------------------|----------|------------------|
| SCALE: NTS | LAST REV DATE: 7-1-2015 | DWN: KWB | DWG NO: CIS.TX.6 |
|------------|-------------------------|----------|------------------|