


CONTACT DOUG BOONE W/ QUESTIONS

REPLACE ALL TRANSFORMER PADS & REPLACE TRANSFORMERS AS NEEDED

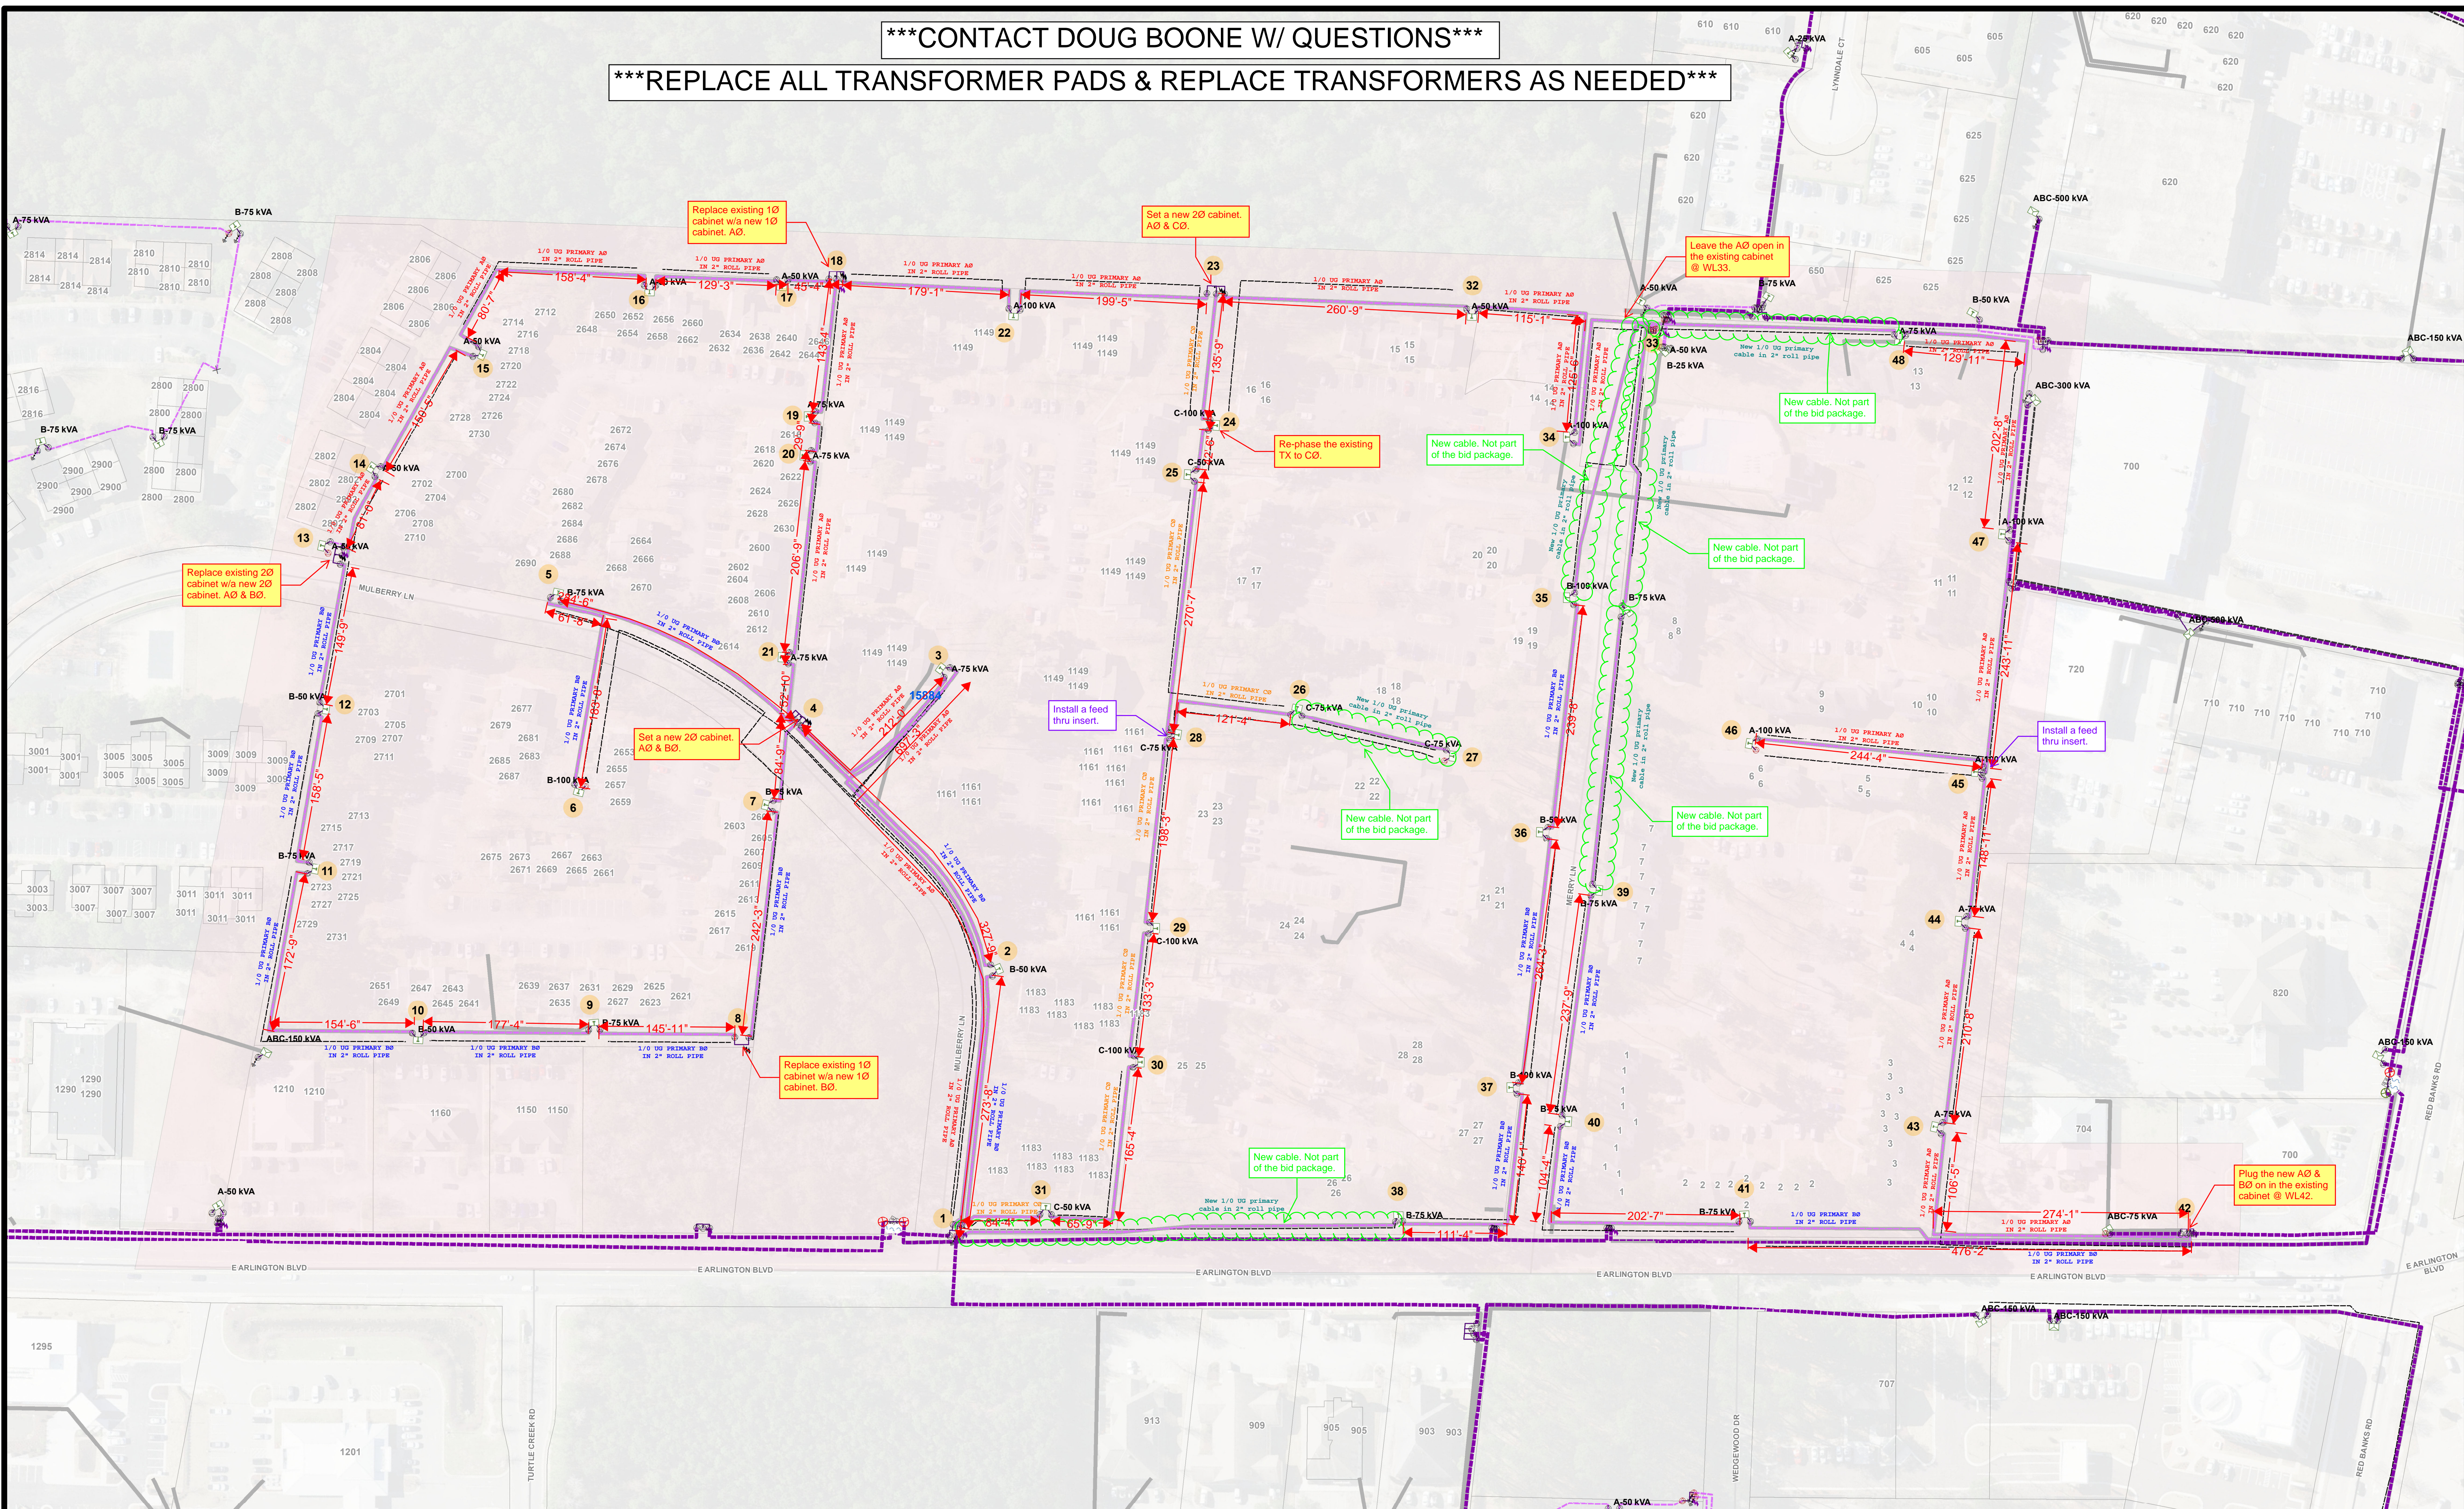

Comments:

1:900
240.59

Electric Engineering Department


Author:	dunmmw	Ticket :	
Date:	3/25/2026	Work date:	
Project #:	ECO 25-26	Good thru:	
Task #:	3000EBS	Update on:	

Greenville Utilities
 3355 NC 43 N
 PO Box 1847
 Greenville, NC 27835



WO# 387005

Pitt County Greenville North Carolina
SOUTHGATE APARTMENT'S
CABLE REPLACEMENT



1 inch = 75 feet