


CONSTRUCTION NOTE:  
 GREENVILLE UTILITIES WILL PROVIDE STRONGWELL OIL CONTAINMENT WALLS, AND SPI 18" PETRO-BARRIER WITH 24" TOP HAT FILTER.  
 SEE APPENDIX K FOR SPI FILTER DETAILS.

See Appendix J for STRONGWELL Oil Containment Wall details.

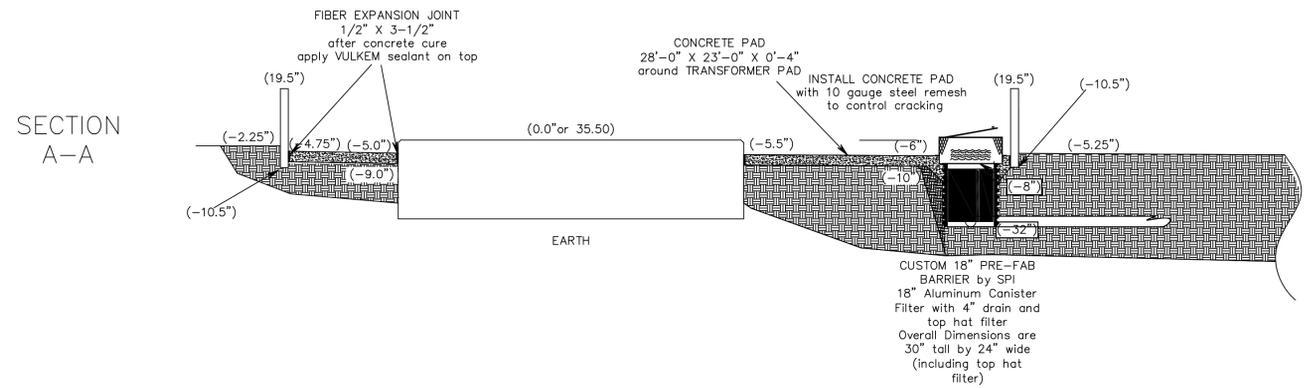

NO.	1.A	REVISIONS	BOVIET SUBSTATION PRELIMINARY DESIGN RMC 3/23/2026	GREENVILLE UTILITIES Greenville, North Carolina	BOVIET SUBSTATION 115 TO 15 kV TRANSFORMER No. 1 & No. 2 OIL CONTAINMENT FOUNDATION	PRELIMINARY	DWG. NO.

DWN.	DATE	DWG. NO.
CKD.	APPD.	
SCALE: PRINT @ 3/8"=1'		