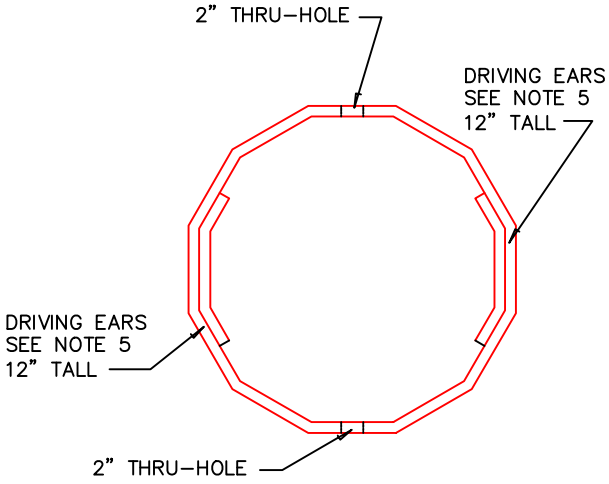

SECTION A-A
N.T.S

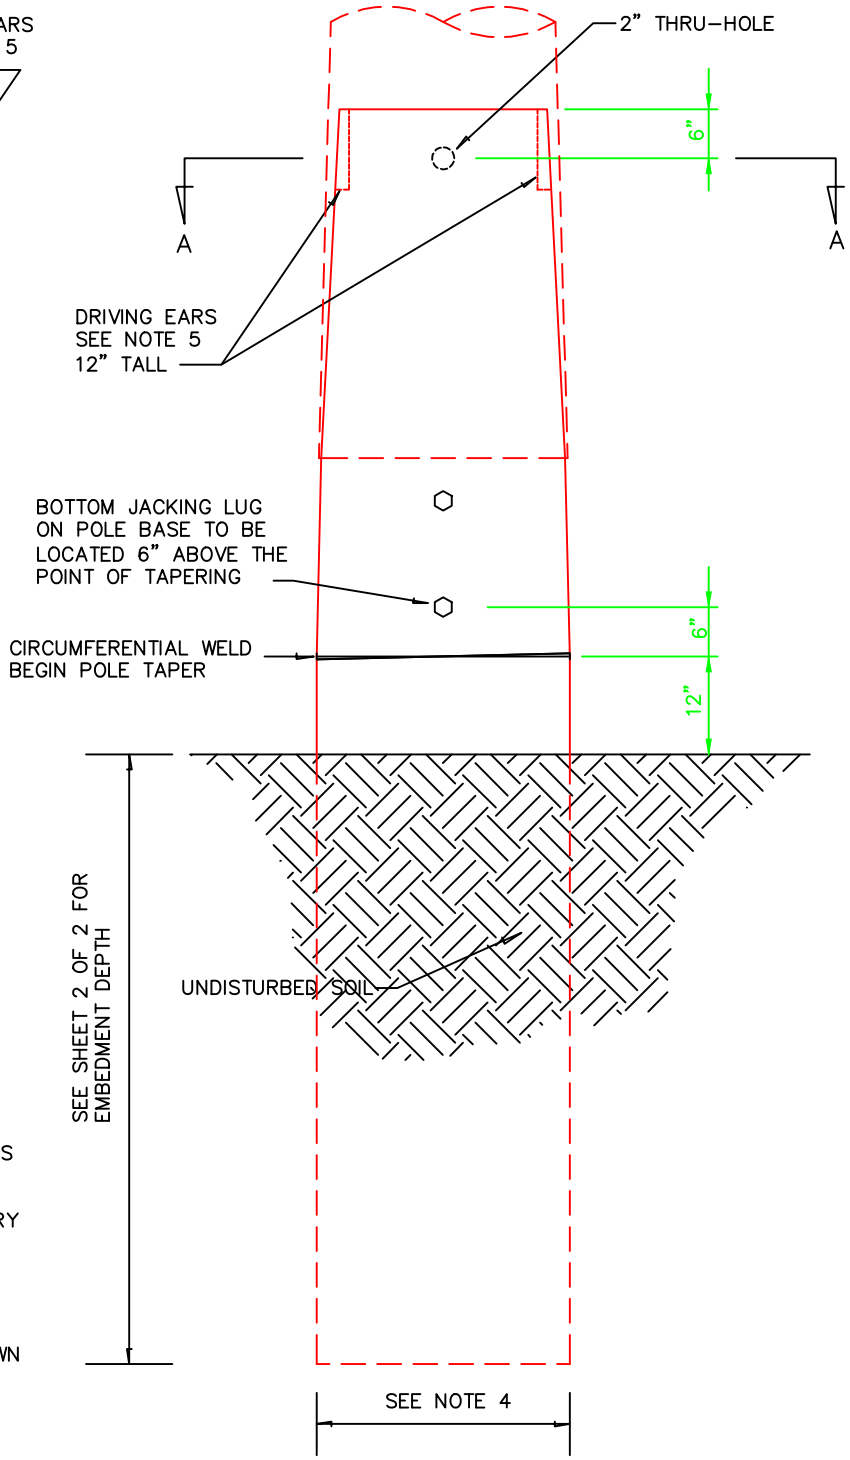

NOTES:

1. VIBRATORY POLE BASE TO BE INSTALLED USING VIBRATORY HAMMER, THE FREQUENCY AND STROKE AMPLITUDE RANGES FOR INSTALLATION OF THE POLE BASE TO BE PER MANUFACTURERS RECOMMENDATIONS.
2. TAPER OF POLE TO MATCH TAPER OF VIBRATORY POLE BASE.
3. OVERLAP LENGTH TO BE DETERMINED BY MANUFACTURER.
4. VIBRATORY BASE DIAMETERS AND DEPTHS SHOWN ON SHEET 2 OF 2 ARE MINIMUM. POLE MANUFACTURER IS TO VERIFY VIBRATORY POLE BASE IS ADEQUATE FOR DESIGN LOADS.
5. MANUFACTURER SHALL DETERMINE ADEQUATE SIZE OF DRIVING EARS.

DWG. REF.	ea.	LIST OF MATERIALS DESCRIPTION	ITEM	DET.
	1	VIBRATORY POLE BASE	–	

GREENVILLE UTILITIES COMMISSION
GREENVILLE, NORTH CAROLINA

Greenville Utilities

VIBRATORY DRIVEN POLE BASE

DWN. JLS		DATE: 05/01/2020	
CKD. KW		APPD. KW	
SCALE: N.T.S.		SHEET: 1 OF 2	
DATE	REVISION	DATE	REVISION

DWG. NO.
TMF-VPB